

For Non-Health Hazard Applications

Job Name _____

Contractor _____

Job Location _____

Approval _____

Engineer _____

Contractor's P.O. No. _____


Approval _____

Representative _____


Piping / Recirculation Diagram

Emergency Tempering Valves

Hot Water Recirculation*

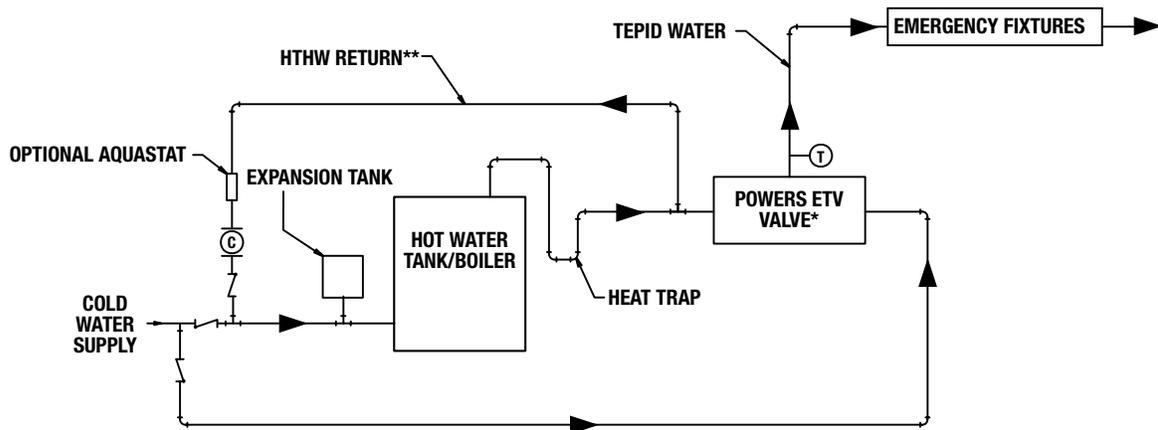

Tepid Water Recirculation*

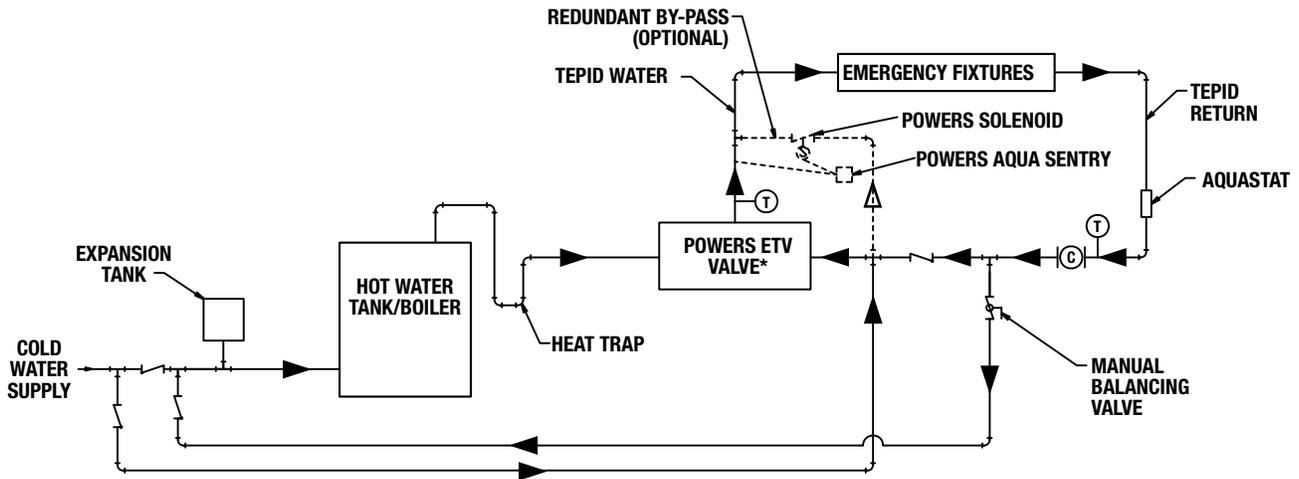


*** USE ONLY WHEN REQUIRED MINIMUM FLOW IS GREATER THAN OR EQUAL TO THE VALVE MINIMUM FLOW (REFER TO LITERATURE).**

(T)	TEMP/PRESSURE GAUGE
▶	FLOW DIRECTION
⌋	CHECK VALVE
⊥	BALL VALVE
⊥	AUTOMATIC BALANCING VALVE
(C)	CIRCULATOR

Powers product specifications in U.S. customary units and metric are approximate and are provided for reference only. For precise measurements, please contact Powers Technical Service. Powers reserves the right to change or modify product design, construction, specifications, or materials without prior notice and without incurring any obligation to make such changes and modifications on Powers products previously or subsequently sold.

Tepid Water Recirculation*

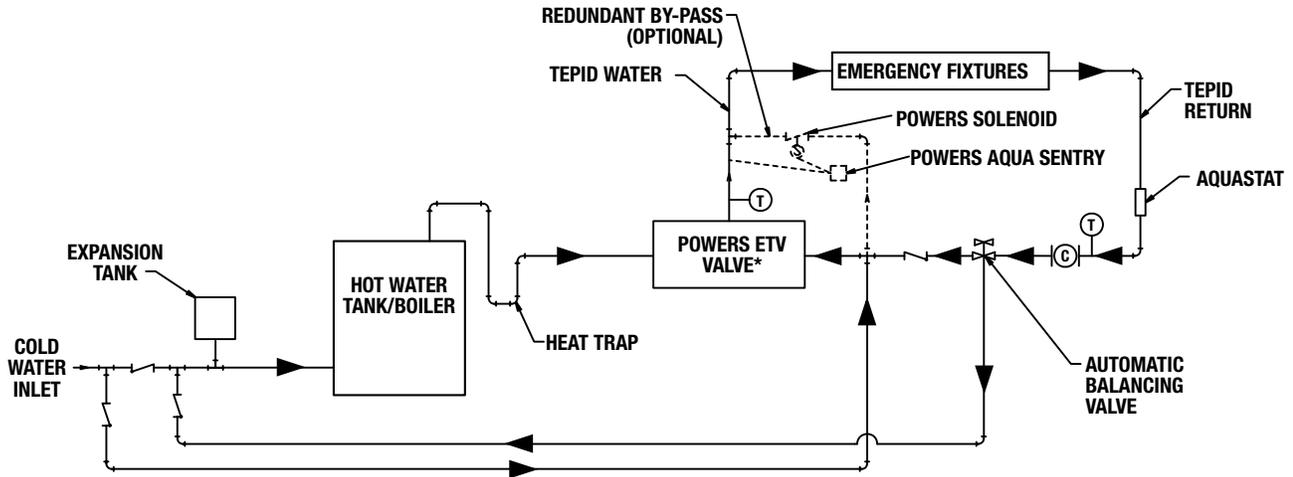

* MUST RUN RECIRC PUMP CONTINUOUSLY WHEN REQUIRED MINIMUM FLOW IS LESS THAN OR EQUAL TO THE VALVE MINIMUM FLOW (REFER TO LITERATURE).

	TEMP/PRESSURE GAUGE
	FLOW DIRECTION
	CHECK VALVE
	BALL VALVE
	AUTOMATIC BALANCING VALVE
	CIRCULATOR

POWERS™

A WATTS Brand

USA: Tel: (800) 669-5430 • Fax: (847) 229-0526 • PowersControls.com
 Canada: Tel: (905) 332-4090 • Fax: (905) 332-7068 • PowersControls.ca
 Latin America: Tel: (52) 81-1001-8600 • PowersControls.com