Job Name	Contractor
Job Location	Approval
Engineer	Contractor's P.O. No.
Approval	Representative

HydroGuard® XP Series Emergency Tempering Valve

Supply Fixture with Cold Water Bypass Top Inlets/Bottom Outlet Semi-Recessed Cabinet

Features

- Powers' Advanced Thermal Actuator provides precise temperature control
- Exclusive internal cold water bypass ensures cold water flow in the event of loss of hot water
- Flow effectively shuts down upon loss of cold water supply when tested under the condition specified in ASSE 1071 standard
- Vandal-resistant locking mechanism to secure temperature setting
- Factory tested
- · Rough bronze and chrome finishes
- Checkstops to prevent cross flow

US Patent 6,575,377









Advanced Thermal Activation

Specifications


Connections	½" (15mm) inlets and outlet
Maximum Operating Pressure	125 psi (861 kPa)
Maximum Hot Water Temperature	180°F (82°C)
Temperature Adjustment Range	60 - 95°F (15 - 35°C)
Factory Set Temperature*	85°F (29°C)
Bypass flow rate at 30 psid*	6.5 gpm (25 lpm)
Maximum flow with cold water shutoff* $\ldots\ldots$	0.5 gpm (1.9 lpm)
Listing-Valve Only	ASSE 1071 and IAPMO UPC


^{*}When tested under conditions specified in ASSE 1071 Standard

Capacity


Flow Capacity at 85°F (29.4°C)										
		Pressure Drop Across Valve								
Min. Flow	C	5 psi	10 psi	15 psi	20 psi	30 psi	45 psi	60 psi		
Model	to ASSE 1071	C _v	(34 kPa)	(69 kPa)	(103 kPa)	(138 kPa)	(207 kPa)	(310 kPa)	(414 kPa)	
ES150	1.0 gpm	1.59	3.6 gpm	5.0 gpm	6.2 gpm	7.1 gpm	8.7 gpm	10.7 gpm	12.3 gpm	
E3130	3.8 lpm		13.6 lpm	18.9 lpm	23.5 lpm	26.9 lpm	32.9 lpm	40.5 lpm	46.6 lpm	



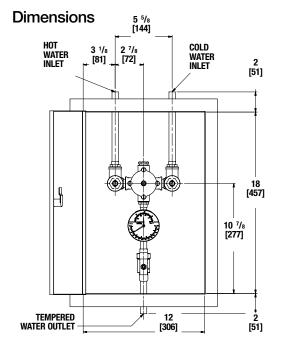

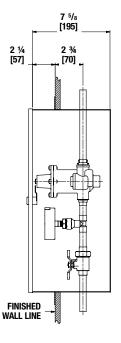

Note: Dimensions are shown ±1/2" Dimensions in parentheses are in mm

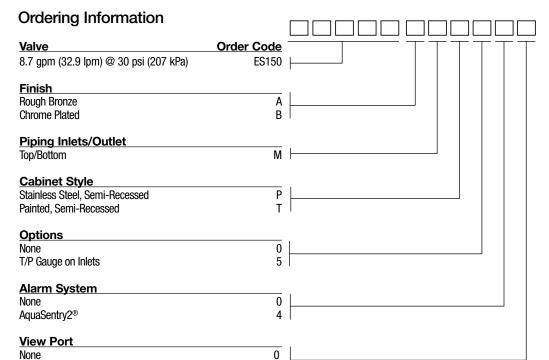

W

Recirculation Piping Diagram

Please see Piping Diagram Section of this catalog.

Typical Specification

Window

Cabinet Supply Fixture for supplying tepid water to emergency fixtures shall be factory assembled, tested and include a stainless steel or painted steel cabinet. Thermostatic mixing valve must have internal cold-water bypass system to ensure flow in the event of valve failure or loss of hot water supply. Supply fixture also includes copper piping, ball valve(s) and temperature/pressure gauge for diagnostics. The valve shall be listed to ASSE 1071 and IAPMO UPC, provide precise temperature control over a wide range of flow conditions, and effectively shut down on loss of cold water. The valve shall feature paraffin-based actuation technology and checkstops to prevent cross flow. The valve shall be factory set to 85°F (29°C) with a lockable mean of securing the temperature.

The valve shall be Powers' model ES150 _ _ _ . All alternatives must have written approval prior to bidding.



A WATTS Brand

USA: Tel: (800) 669-5430 • Fax: (847) 229-0526 • PowersControls.com

Canada: Tel: (905) 332-4090 • Fax: (905) 332-7068 • PowersControls.ca

Latin America: Tel: (52) 81-1001-8600 • PowersControls.com